




Z9A-pHMS-UG

CHEMICAL pH NEUTRALIZATION SYSTEM DETAIL FOR UNDERGROUND METHOD #1B INSTALLATION

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

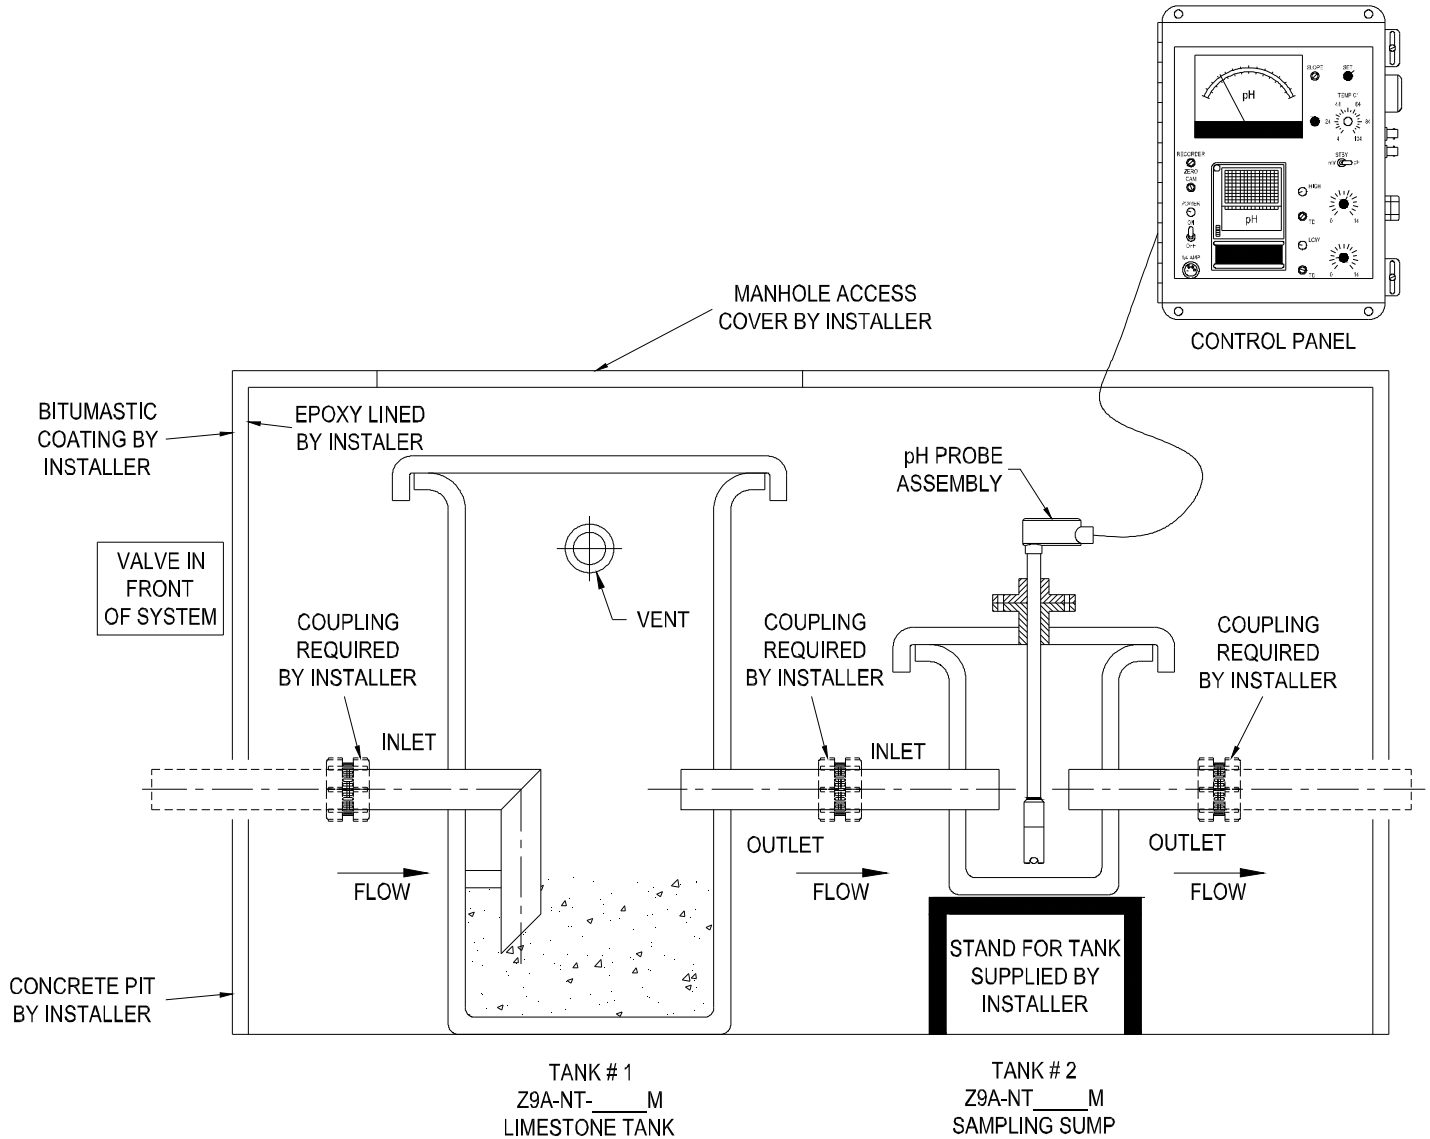

ENGINEERING SPECIFICATION: Z9A-pHMS-UG

pH Monitor System is manufactured by Zurn Industries. The system is complete with 1) a HDPE ___ gallon Limestone (Neutralization) Tank. 2) a HDPE ___ gallon sampling tank with bolted, gasketed cover. 3) a pH probe assembly consisting of an immersion type electrode and mounting brackets constructed of Polypropylene. 4) A Nema rated pH control panel housing with an Audible/Visual alarm with push button silencing relax. Unit to include up to 10 feet of cable for hook up from junction box relay to pH control panel. Contractor shall install equipment and components, in accordance with manufacturer's recommendations.

Note:

Manhole access cover
must be wider than tank.

* Regularly furnished unless otherwise specified.

Zurn Industries, LLC | Specification Drainage Operation
1801 Pittsburgh Avenue, Erie, PA U.S.A. 16502 · Ph. 855-663-9876, Fax 814-454-7929
In Canada | Zurn Industries Limited
3544 Nashua Drive, Mississauga, Ontario L4V 1L2 · Ph. 905-405-8272, Fax 905-405-1292
www.zurn.com

Rev. -
Date: 03/05/14
C.N. No. 130661
Prod. | Dwg. No. Z9A-pHMS-UG