Z627-104

ISOLATION DECK ADJUSTABLE HEAVY-DUTY DRAIN

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

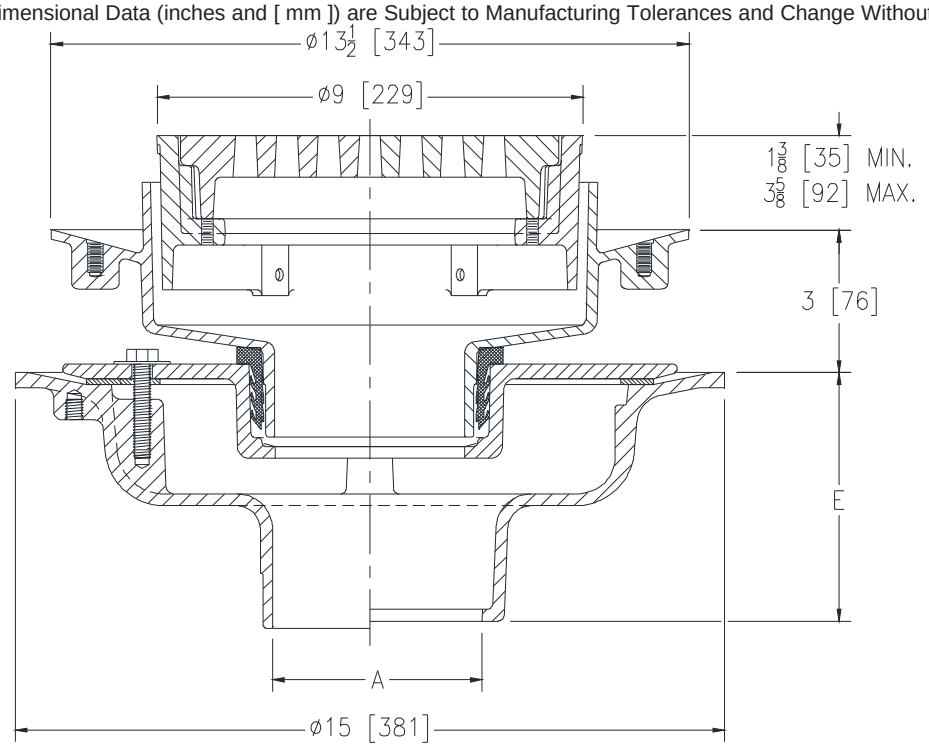

A Pipe Size [mm]	Approx. Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm²]
2, 3, 4 [51, 76, 102]	65 [29]	18 [116]
5, 6 [127, 152]		

ENGINEERING SPECIFICATION: ZURN Z627-104
Adjustable isolation deck drain, Dura-Coated cast iron upper and lower bodies, clamp collar, neoprene flex gasket, isolation nipple and 9" [229mm] diameter round heavy-duty top drain.

OPTIONS (Check/specify appropriate options)

PIPE SIZE	(Specify size/type) **OUTLET**		**'E' BODY HT. DIM.**
2,3,4,6 [51,76,102,152]	____ IC	Inside Caulk	5-1/4 [133]
2,3,4,6 [51,76,102,152]	____ IG	Inside Gasket	5-1/4 [133]
2,3,4,6 [51,76,102,152]	____ IP	Threaded	3-3/4 [95]
2,3,4,6 [51,76,102,152]	____ NH	No-Hub	5-1/4 [133]
2,3,4 [51,76,102]	____ NL	Neo-Loc	4-5/8 [117]

PREFIXES

- ____ Z D.C.C.I. Body and Top*
- ____ ZB D.C.C.I Body w/Polished Bronze Top (Add 3/16 [5] to 1-3/8 [35] - 3-5/8 [92] dim. & 3/4 [19] to 9 [229] dim.)
- ____ ZN D.C.C.I Body w/Polished Nickel Bronze Top (Add 3/16 [5] to 1-3/8 [35] - 3-5/8 [92] dim. & 3/4 [19] to 9 [229] dim.)

SUFFIXES

- ____ -C Underdeck Clamp (Lower Body)
- ____ -CC Clamp Collar (Upper Body)
- ____ -DG Duresist Grate
- ____ -F Extension
- ____ -G Galvanized Cast Iron
- ____ -R Sump Receiver (Lower Body)
- ____ -SC Solid Cover
- ____ -TS Top Secured with Slotted Screws
- ____ -VP Vandal-Proof Secured Top
- ____ -Y Sediment Bucket

* Regularly furnished unless otherwise specified.

Zurn Industries, LLC | **Specification Drainage Operation**
1801 Pittsburgh Avenue, Erie, PA U.S.A. 16502 · Ph. 855-663-9876, Fax 814-454-7929
In Canada | **Zurn Industries Limited**
3544 Nashua Drive, Mississauga, Ontario L4V 1L2 · Ph. 905-405-8272, Fax 905-405-1292
www.zurn.com

Rev. -
Date: 05/12/17
C.N. No. 136871
Prod. | Dwg. No. Z627-104