Z1203-N-50

ADJUSTABLE HORIZONTAL SIPHON JET NO-HUB
W/ FLUSH VALVE SUPPLY SUPPORT

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

Product Number	Approx. Wt. Lbs. [kg]
Z1203-NL4-50	67 [30]
Z1203-NR4-50	

Note:

1. Min. 'P' Dim. Obtainable = 2 [51] with cut standard coupling
2. Feet bolted to floor using min. 1/2 [13] dia. bolts and back slots on carrier feet.
3. Back anchor foot required for secure installation.

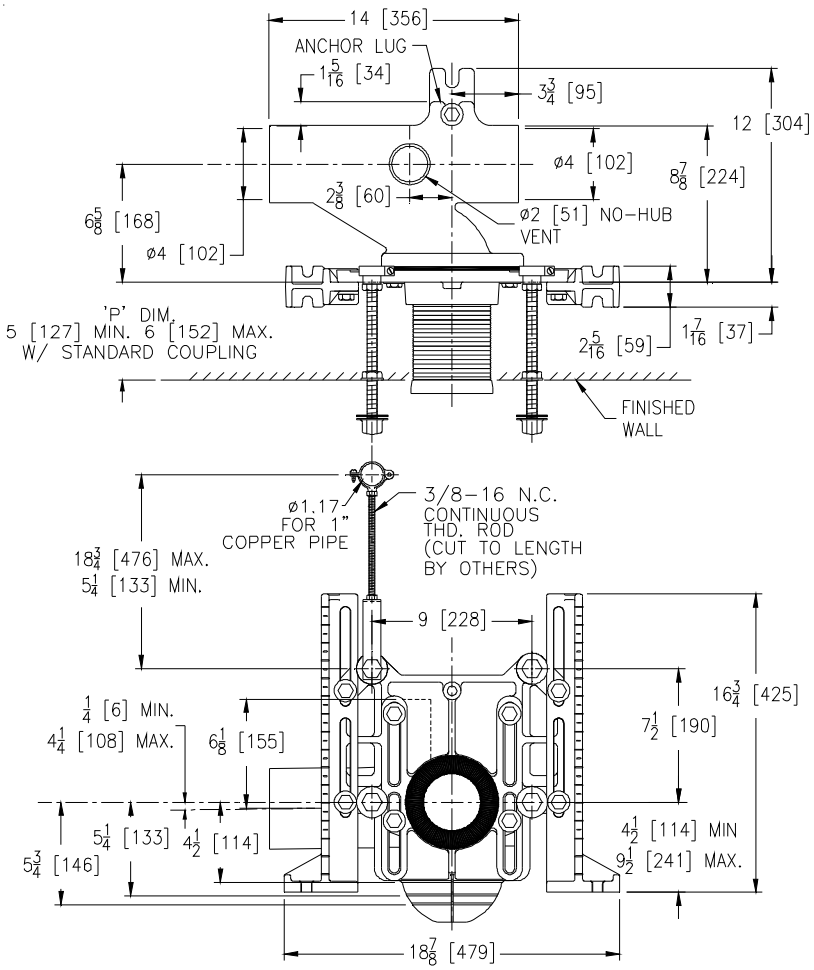

ENGINEERING SPECIFICATION

ZURN Z1203-N()-50

Adjustable, horizontal siphon jet water closet "Rigid System" with 4" [102mm] No-Hub connections. Complete with Dura-Coated cast iron right or left hand main fitting, with 2" [51mm] vent, adjustable gasketed faceplate, universal floor mounted foot supports, corrosion resistant adjustable ABS coupling with integral test cap, fixture bolts, trim, and stud protectors, rear anchor tie down and bonded "Neo-Seal" gasket. Includes flush valve support.

OPTIONS (Check/specify appropriate options)

____ Z1203-NR4-50 4 [102] No-Hub Right Hand Inlet with Flow to Left
____ Z1203-NL4-50 4 [102] No-Hub Left Hand Inlet with Flow to Right

NOTE:
Flush valve support can be mounted on either right or left top of studs.

PREFIXES

____ Z D.C.C.I. System with Zurn "ZZ" Adjustable Coupling*
____ ZQ D.C.C.I. System with NPT Faceplate, Non-Adjustable Coupling

SUFFIXES

____ -A Auxiliary Support Assembly (for 'P' Dim. Greater Than 18 [457])
____ -B Blowout Type Fixture Support
____ -CC Corrosion Resistant Cast Iron Coupling (6 [151] to 12 [305])
____ -CL Coupling Length Other Than Standard 6 [152] (Specify Length Required)
____ -F Floor Mounted, Back Outlet Fixture Support
____ -JC 2 [51] Auxiliary Inlet with Sanitary Sweep on Faceplate Centerline
____ -M Auxiliary Foot Support (for 'P' Dim. 10 -18 [254 - 457])
____ -PF Pre-Fab Foot
____ -PS Pre-Fab Slotted Foot
____ -RYK Unistrut Pre-Fab Foot
____ -VP Vandal-Proof Trim
____ -X3 3 [76] Carrier Foot Extension Assembly
____ -X4 4 [102] Carrier Foot Extension Assembly
____ -45 Finishing Frame for Siphon Jet System (for Blowout System specify -45-B)

* Regularly furnished unless otherwise specified.

Zurn Industries, LLC | **Specification Drainage Operation**
1801 Pittsburgh Avenue, Erie, PA U.S.A. 16502 · Ph. 855-663-9876, Fax 814-454-7929
In Canada | **Zurn Industries Limited**
3544 Nashua Drive, Mississauga, Ontario L4V 1L2 · Ph. 905-405-8272, Fax 905-405-1292
www.zurn.com

Rev. A
Date: 10/10/2017
C.N. No. 138597
Prod. | Dwg. No. Z1203-N-50